


WIRING DIAGRAM

MAIN PANEL TYPICAL COND UNIT WIRING DIAGRAM
MAIN CONTROL PANEL - TYPICAL EVAPORATOR WIRING

AIR & ELECTRIC DEFOST



P.2 OF 2

(ALSO REFER TO P.10F 2)

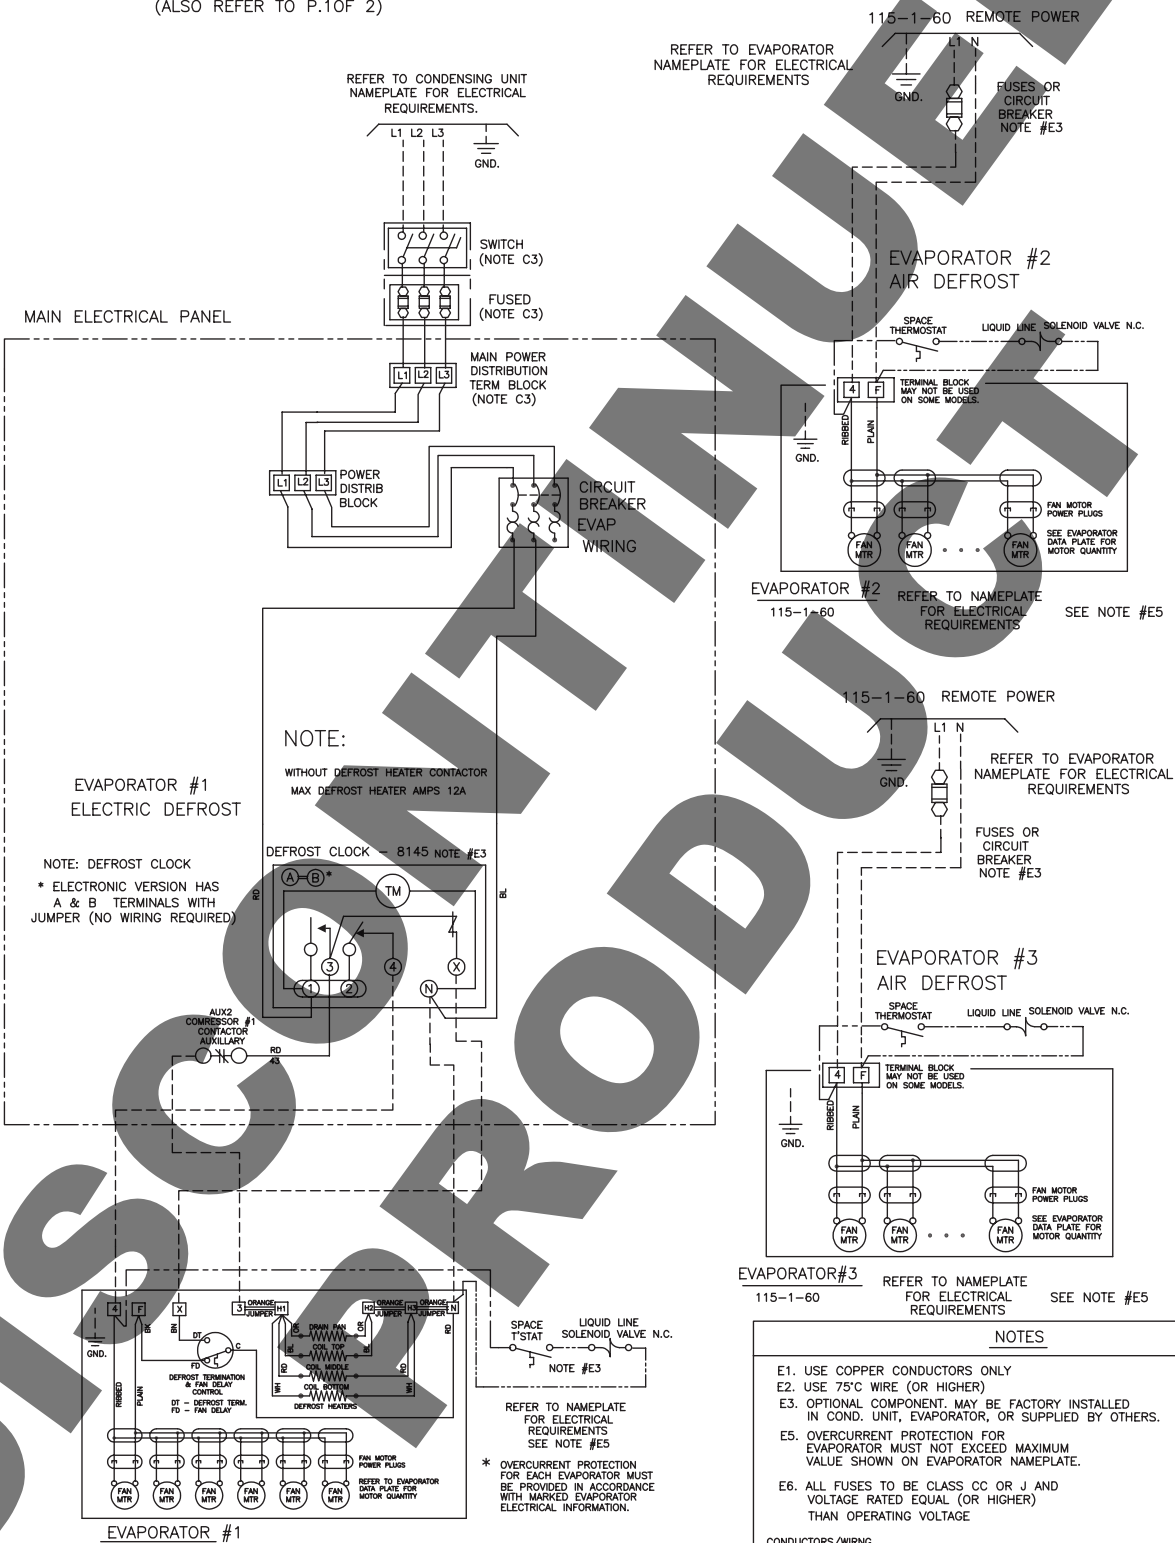

NOTE:
WITHOUT DEFOST HEATER CONTACTOR
MAX DEFOST HEATER AMPS 12A

NOTE: DEFOST CLOCK
* ELECTRONIC VERSION HAS
A & B TERMINALS WITH
JUMPER (NO WIRING REQUIRED)

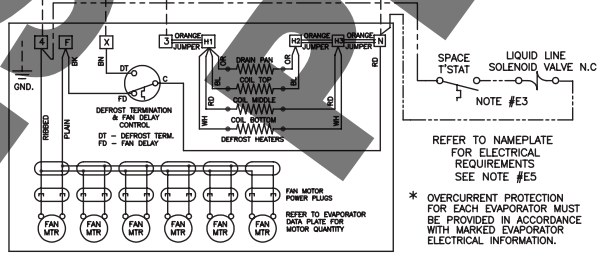

* OVERCURRENT PROTECTION
FOR EACH EVAPORATOR MUST
BE PROVIDED IN ACCORDANCE
WITH MARKED EVAPORATOR
ELECTRICAL INFORMATION.

- NOTES**
- E1. USE COPPER CONDUCTORS ONLY
 - E2. USE 75°C WIRE (OR HIGHER)
 - E3. OPTIONAL COMPONENT; MAY BE FACTORY INSTALLED IN COND. UNIT, EVAPORATOR, OR SUPPLIED BY OTHERS.
 - E5. OVERCURRENT PROTECTION FOR EVAPORATOR MUST NOT EXCEED MAXIMUM VALUE SHOWN ON EVAPORATOR NAMEPLATE.
 - E6. ALL FUSES TO BE CLASS CC OR J AND VOLTAGE RATED EQUAL (OR HIGHER) THAN OPERATING VOLTAGE

CONDUCTORS/WIRING

— FACTORY WIRING
- - - OPTIONAL WIRING
- - - WIRING BY OTHERS

ALL FIELD WIRING MUST BE DONE IN COMPLIANCE WITH ALL APPLICABLE LOCAL AND NATIONAL CODES.

REVISIONS		DIAGRAM NUMBER
DATE	LTR	
JAN23/05	A	T3A1A-

P.2 OF 2

NOTES:

**DISCONTINUED
PRODUCT**

System	
Model Number	Date of Start-Up
Serial Number	Service Contractor
Refrigerant	Phone
Electrical Supply	Fax

DISCONTINUED PRODUCT



**NATIONAL REFRIGERATION &
AIR CONDITIONING CANADA CORP.**



CANADA

159 ROY BLVD., BRANTFORD, ONTARIO, CANADA N3R 7K1
PHONE: 1-800-463-9517 (519)751-0444 FAX (519)753-1140

USA

985 WHEELER WAY, LANGHORNE, PA. 19047 USA
PHONE: 1-888-KEEPUS1 OR 1-888-533-7871

Due to National Refrigeration's policy of continuous product improvement, we reserve the right to make changes without notice.